

Ref. VDA/12/2023/04


Date 13/12/2023

Electricity Supply and Transformer – Power Requirement.

Power Requirement - 1250 KVA

Source - JBVNL

Backup Power Source - 50 kv DG Set in 5 nos.

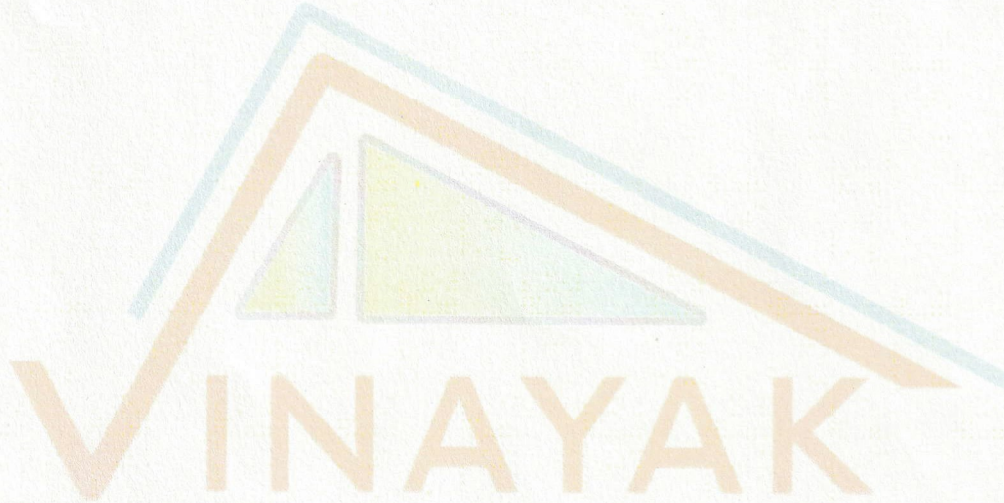

VINAYAK DEVELOPERS AND ASSOCIATES

Anuj Kumar

PARTNER